



USA
 3833 SALA Way
 Red Wing, MN 55066-5005
 Toll Free: 800-328-6146
 Phone: (651) 388-8282
 Fax: (651) 388-5065
 www.capitalsafety.com

Canada
 260 Export Boulevard
 Mississauga, Ontario L5S 1Y9
 Toll Free: 800-387-7484
 Phone: (905) 795-9333
 Fax: (905) 795-8777
 www.capitalsafety.com

Instructions for the following series products:

Floor-to-Ceiling Debris Netting

Model Number: 4102000

USER INSTRUCTION Floor-to-Ceiling DEBRIS NETTING

This instruction is intended to meet the Manufacturer's Instructions as required by ANSI Z359.1 and should be used as part of an employee training program as required by OSHA.

DESCRIPTION

1.0 APPLICATIONS

1.1 PURPOSE: The Floor-to-Ceiling Debris Netting provides debris containment and a passive fall prevention barrier at exterior openings of the building perimeter. It also serves as a personnel protective guardrail system.

WARNING: Use this product only for its intended use. Do not alter or intentionally misuse this netting.

1.2 TRAINING: This equipment must be installed and used by persons trained in its correct application and use. See section 4.

1.3 Refer to applicable local, state and federal (OSHA 1926.502) requirements governing occupational safety.

2.0 INSTALLATION AND USE

2.1 PLAN your system before installation. Consider all factors that will affect your safety during use of this netting. The following list gives important points to consider when planning your system:

- A. ANCHORAGE:** Anchoring concrete should have a minimum strength of 3,000 psi.
- B. REUSE & REPLACEMENT:** Any netting which has been subjected to excessive impact forces or exhibits damage, as described in section 3.2, must be removed from service immediately and destroyed by the user, the rescuer, or an authorized person.


2.2 INSTALLATION: Figure 1 illustrates installation of the debris netting. Installation procedures are as follows:

- Step 1. Don appropriate safety equipment for working near a leading edge or other fall hazard.
- Step 2. String top and bottom cables (not included) through eye bolts (not include) anchored in concrete columns.
- Step 3. Hang netting panels from top cable with the top edge snap hooks. (The excess fine mesh debris liner flap should be positioned at the floor end of each netting section.)
- Step 4. Fasten adjoining netting panels to one another with the side edge snap hooks.
- Step 5. Fasten the bottom edge snap hooks to the bottom cable.
- Step 6. Secure the fine mesh debris flap to the floor with tie-down plates (not included) and concrete nails (not included).

2.3 BEFORE EACH WORK SHIFT inspect the installed netting according to section 3.2.

2.4 REMOVAL:

- Step 1. Don appropriate safety equipment for working near a leading edge or other fall hazard.
- Step 2. Pry concrete nails from the floor with a claw hammer or crowbar and remove the tie-down plates.
- Step 3. Unfasten the bottom, side, and top snap hooks.
- Step 4. Remove netting panels.

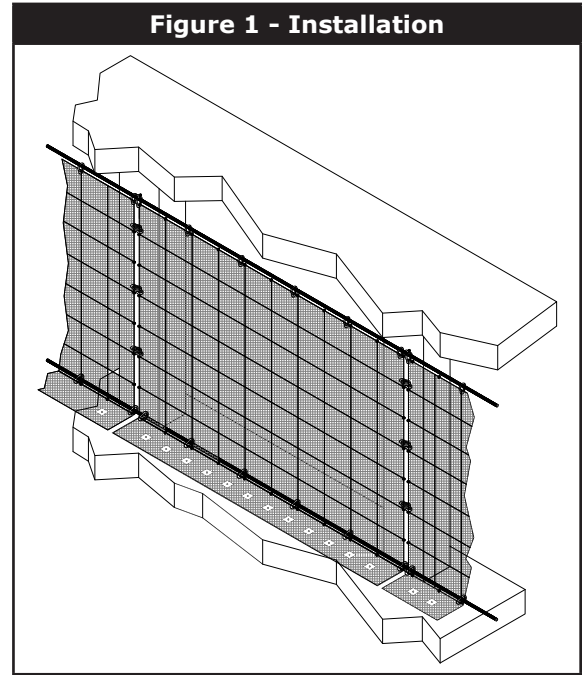

3.0 INSPECTION

3.1 FREQUENCY

BEFORE EACH WORK SHIFT: Inspect the installed netting according to section 3.2.

3.2 INSPECTION:

Inspect the netting for damage such as cut or frayed cords. Inspect for mildew, wear, or other damage that may affect strength.

Remove any debris that may have collected on the netting.

3.3 If inspection reveals a defective or unsafe condition, lock out the area from service until the condition is resolved.

4.0 TRAINING

4.1 The user and purchaser of this netting must be familiar with the instructions, operating characteristics, application limits, and the consequences of improper use of this equipment. Users and purchasers must be trained in the correct care and use of this netting.

5.0 SPECIFICATIONS

Exterior Netting Layers: 9.5 ft x 30 ft (2.9 m x 9.1 m) - 9.5 in (24 cm) square mesh, flame retardant treated.

Internal Fine Mesh Debris Layer: 10 ft x 30 ft (3 m x 9.1 m) - 1/8 in (.3175 cm) square mesh, flame retardant treated.

Custom Sizes are Available: Contact Capital Safety.